

| ECN#  | APP'D./DATE | REV. |
|-------|-------------|------|
| 10419 | TAM 6/6/94  | 10   |

**SAFETY ORGANIZATION(S):**

THIS MODULE HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET.

UL RECOGNIZED                   UL 498  
 CSA CERTIFIED                CSA 22.2, NO.0,0.4,42  
 VDE APPROVED                 VDE 625

**OPERATING SPECIFICATIONS:**

LINE VOLTAGE/CURRENT:   5 AMP, 120 VAC  
                                   4 AMP./40°C, 250 VAC  
 LINE FREQUENCY: 47-440Hz

**RELIABILITY SPECIFICATIONS:**

STORAGE TEMPERATURE: -55°C TO +85°C  
 HUMIDITY: 21 DAYS @ 40°C 95% RH  
 CURRENT OVERLOAD TEST: 6 TIMES RATED CURRENT FOR 8 SECONDS

**TEST SPECIFICATIONS:**

LINE/GROUND AND LINE/LINE   6000MΩ (MIN) AT 100VDC  
 INSULATION RESISTANCE:       20°C AND 50% RH




**RECOMMENDED RECEIVING INSPECTION HIPOT:**

LINES TO GROUND, 1500 VAC FOR 1 MINUTE  
 LINE TO LINE: 1450 VDC FOR 1 MINUTE

**FILTER APPROVAL:**

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

U.S. PATENT No. 4,488,201

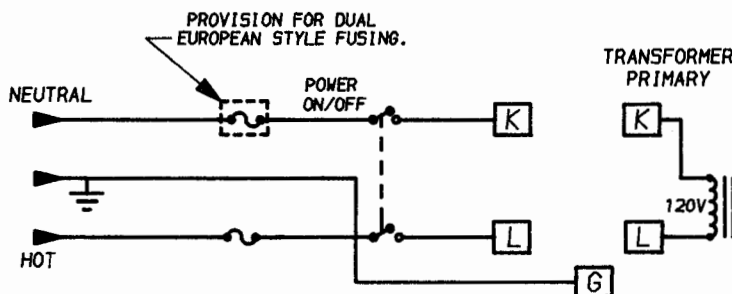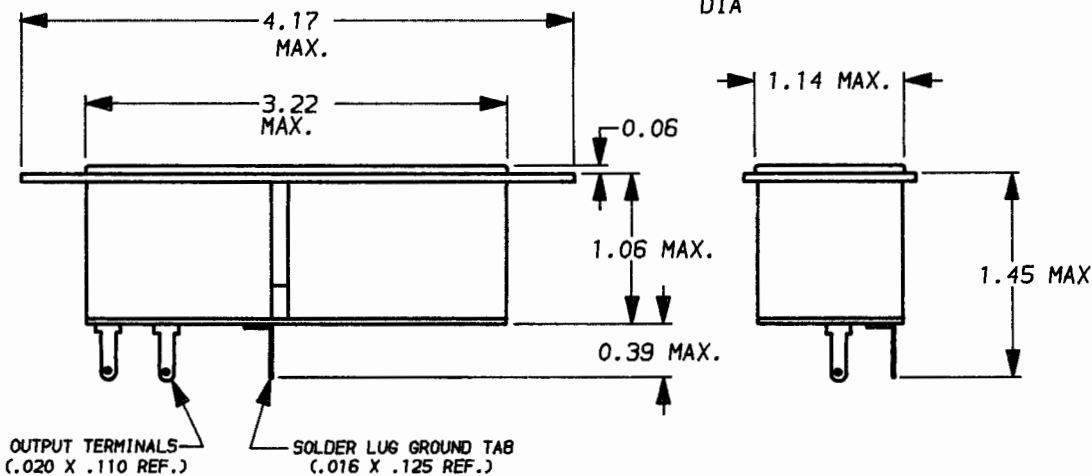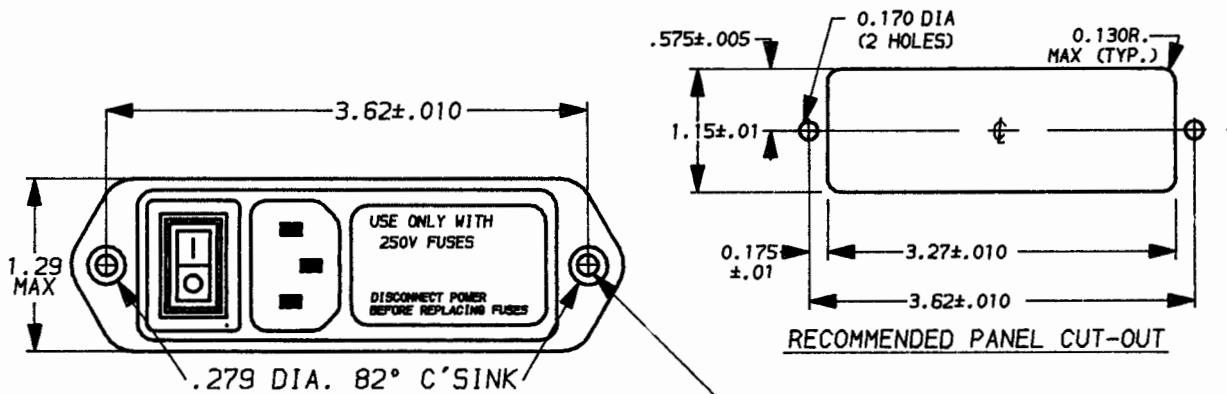

|  |  |
|--|--|
|  |  |
|  |  |
|  |  |
|  |  |

UNLESS OTHERWISE SPECIFIED,  
 TOLERANCE TO BE ±.025  
 MATERIAL & FINISH: AS SUPPLIED  
 This document is proprietary to CORCOM INC.  
 and is not to be reproduced nor used for  
 manufacturing purposes except on CORCOM'S  
 prior written consent.

|   |                 |
|---|-----------------|
| <b>corcom</b><br>LIBERTYVILLE, IL 60048 |                 |
| <b>POWER LINE FILTER</b>                |                 |
| DATE: 4-18-94                           | CATALOG NO.     |
| APPRVD.                                 | <b>6VM1S.10</b> |
| CAD NO.                                 | <b>6VM1S.10</b> |